

DeltaV SIS™ Auxiliary Components



Pair the DTA Inverting module or the ETA Direct module with an Auxiliary Relay Diode module to achieve additional functionality.

- Enables diagnostics of field wiring all the way to a high-current discrete end device
- Monitors that the relay changed state correctly
- Enables de-energize-to-actuate applications, even with higher current ratings
- Enables energize-to-actuate applications with current ratings above 500 mA

Introduction

In most cases, DeltaV SIS system will connect to either 4 – 20 mA analog signal devices or discrete I/O devices rated at up to 500 mA per channel. Almost all the outputs will be De-energize-to-Trip.

However, there will be some output signals that require higher currents and some devices, mainly in fire and gas applications, that require energize-to-trip functionality. For applications that simply need high current DeltaV offers the Auxiliary Relay Energize to Actuate (ETA Direct) module. For applications where the current to the final device needs to be switched on when the system trips, there is the Auxiliary Relay De-energize to Actuate (Inverting), or DTA-Inverting relay. Either of these relay modules, paired with the Auxiliary Relay Diode module, allows DeltaV SIS platform to meet higher-current discrete output requirements while maintaining its field wiring monitoring and ensuring that the relay changes states correctly.



DELTA V SIS

www.DeltaVSIS.com



EMERSON
Process Management

Benefits

Enables energize-to-trip applications including line monitoring to the final device and higher current ratings. Some applications, especially in fire and gas, require that the output of a safety loop be energized when a hazardous situation occurs. An example is a motor starter on a fire water pump. DeltaV SIS system has a “de-energize-to-trip” design – it turns off its outputs when there is a safety demand. Our De-Energize to Actuate-Inverting Relay (DTA-Inverting) inverts the output of the logic solver. It sends power to the field device when the logic solver output is switched off. This enables DeltaV SIS system to be used in energize-to-trip applications.

Enables enhanced diagnostics on higher-current discrete outputs. Many safety systems monitor the field wiring from their I/O modules. However, if the I/O channel is connected to a relay, then the monitoring likely only extends as far as the relay in the cabinet. Any wiring failure in the field will go un-noticed until the system is manually tested or fails on demand. These auxiliary components extend DeltaV SIS’ automatic testing of field wiring past the interposing relay.

The majority of SIS applications are de-energize-to-trip. If a de-energize-to-trip output requires more current than the DeltaV SIS Logic Solver can provide on a single channel then we use our Energize to Actuate (ETA) relay to switch off the output when the logic solver output is de-energized, and extend line-monitoring diagnostics to the end device.

The DTA-Inverting and the ETA relay modules incorporate additional circuitry to monitor the integrity of the field wiring all the way to the final device, while also ensuring that it is impossible to accidentally trip the output while performing open and short circuit testing. Their design also provides diagnostics that the relay has switched the output on or off as required.

Product Description

Relay Modules for Fire and Gas Applications

DeltaV SIS system can be used with auxiliary equipment to support fire and gas applications (in accordance with the DeltaV SIS Safety Manual) and other energize to actuate applications. The paired modules available for these applications include:


- Auxiliary Relay De-Energize to Actuate-Inverting (DTA-Inverting), 24 V DC module
- Auxiliary Relay Diode, 24 V DC module.

Auxiliary Relay

De-Energize to Actuate (DTA-Inverting)


The DTA-Inverting relay module has a connection to a single discrete input and a single discrete output channel on a Logic Solver and a connection to a dual 24 V DC power supply. Two field terminals are used to connect to the diode module that is located next to the field actuator.

The DTA-Inverting relay module energizes the field device when the Discrete Out is turned off. The DTA-Inverting relay module is paired with the Relay Diode module to enable the monitoring of the field wiring and the status of the relay. A switch on the Relay Diode module is used to change between energize to actuate and de-energize to actuate. The Auxiliary Relay DTA-Inverting module’s LED shows the state of the relay coil and that power is correctly installed.

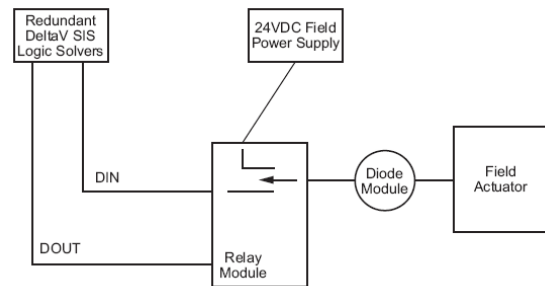


Relay module block diagram

| Auxiliary Relay DTA-Inverting Module | |
|--------------------------------------|---|
| Item | Specifications: |
| Input Power | 24 V DC \pm 20% Contains integrated input OR-ing diodes for redundant 24 V DC inputs |
| Field Power | 5 A @ 24 V DC nominal (depends upon actuator used) |
| Isolation | Power input and logic solvers must be connected to a common ground |
| Discrete out load current | 430 Ω , 55 mA @ 24 V DC input voltage |
| Mounting | DIN rail-mounted |

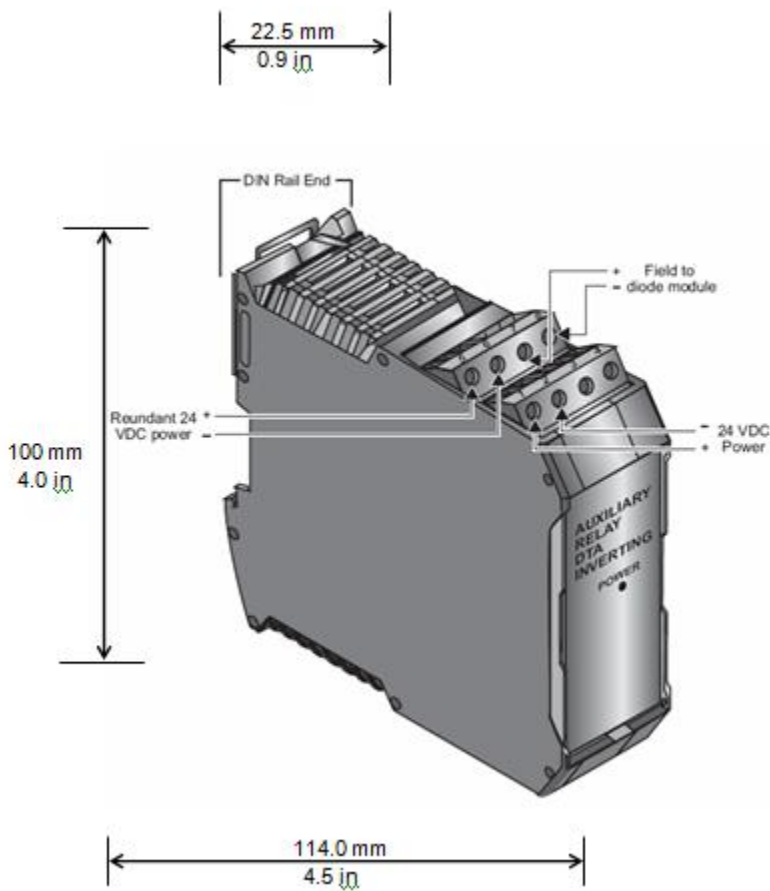

Top view of the Auxiliary Relay DTA-Inverting Module

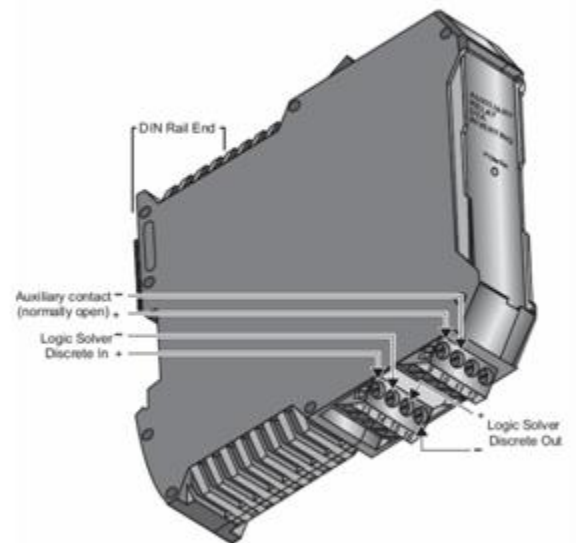

Bottom view of the Auxiliary Relay DTA-Inverting Module (showing the connectors)

Relay Module for High-Current Applications

DeltaV SIS system can be used with auxiliary equipment to support other applications. The paired modules available for other applications include:

- Auxiliary Relay Energize to Actuate (ETA-Direct), 24 V DC module
- Auxiliary Relay Diode, 24 V DC module

Auxiliary Relay Energize to Actuate (ETA-Direct)

The ETA-Direct relay module has a connection to a single discrete input and a single discrete output channel on a Logic Solver and a connection to a dual 24 V DC power supply. Two field terminals are used to connect to the diode module that is located next to the field actuator.

The ETA Direct relay module de-energizes the field device when the Discrete Out is turned off. The ETA Direct relay module is paired with the Relay Diode module to enable the monitoring of the field wiring and the status of the relay. A switch on the Relay Diode module is used to change between energize to actuate and de-energize to actuate. The Auxiliary Relay DTA-Inverting module's LED shows the state of the relay coil and that power is correctly installed.


The connectors on the Auxiliary Relay ETA-direct module are the same as those for the Auxiliary Relay DTA-Inverting module.

| Auxiliary Relay ETA-Direct Module | |
|-----------------------------------|---|
| Item | Specifications: |
| Input Power | 24 V DC \pm 20% Contains integrated input OR-ing diodes for redundant 24 V DC inputs |
| Field Power | 5 A @ 24 V DC nominal (depends upon actuator used) |
| Isolation | Power input and logic solvers must be connected to a common ground |
| Discrete out load current | 430 Ω , 55 mA @ 24 V DC input voltage |
| Mounting | DIN rail-mounted |

Auxiliary Relay Diode Module

The Auxiliary Relay Diode Module must be paired with either of the Auxiliary Relay modules (ETA Direct or DTA-Inverting).

| Auxiliary Relay Diode Module | |
|------------------------------|---|
| Item | Specifications: |
| Mode Selection | Switch selectable between ETA and DTA operation |
| Mounting | Per DIN 43729 |

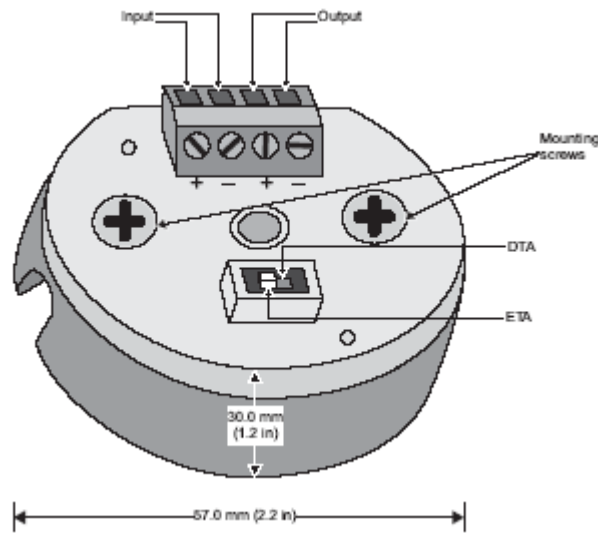

Connectors and switch positions on the Relay Diode module

Use the following table to match the application to the appropriate module.

| Matching the Application to the Appropriate Module | | | |
|--|---------------------|--------------------------------|---|
| Condition of final device in safe state | Application Type | Current rating of final device | Module |
| De-energized (off) | De-energize-to-trip | ≤ 500 mA | None – wire device to Digital Output channel on DeltaV SIS logic solver |
| De-energized (off) | De-energize-to-trip | > 500 mA | Energize to Actuate (ETA) Relay |
| Energized (on) | Energize-to-trip | Any | De-Energize to Actuate-Inverting (DTA-Inverting) Relay |

Ordering Information

| Description | Model Number |
|--|--------------|
| Auxiliary Relay ETA-Direct Module | VS6901 |
| Auxiliary Relay De-Energize to Actuate (DTA-Inverting), 24 V DC module | VS6902 |
| Auxiliary Relay Diode, 24 V DC module | VS6903 |

Prerequisites

- DeltaV v8.3 software or later.

To locate a sales office near you, visit our website at:
www.DeltaVSIS.com

Or call us at:

Asia Pacific: 65.777.8211

Europe, Middle East: 41.41.768.6111

North America, Latin America: +1 800.833.8314 or
+1 512.832.3774

For large power, water, and wastewater applications contact Power and Water Solutions at:

www.EmersonProcess-powerwater.com

Or call us at:

Asia Pacific: 65.777.8211

Europe, Middle East, Africa: 48.22.630.2443

North America, Latin America: +1 412.963.4000

© Emerson Process Management 2009. All rights reserved. For Emerson Process Management trademarks and service marks, go to:
<http://www.emersonprocess.com/home/news/resources/marks.pdf>.

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available on request. We reserve the right to modify or improve the design or specification of such products at any time without notice.



DELTA V SIS

www.DeltaVSIS.com



EMERSON
Process Management