

DeltaV OPC History Server



The DeltaV OPC History Server provides access to historical data in the DeltaV Continuous Historian.

- Historical data transfer from the DeltaV Continuous Historian
- Browsable interface
- Raw, interpolated and calculated data
- Remote viewing of historical data
- Available on the ProfessionalPLUS Station and Application Station

Introduction

The DeltaV OPC History Server makes it easy for external applications to access and retrieve historical data from the DeltaV system using an industry standard, open interface.

Built upon the latest OPC Historical Data Access specification, the DeltaV OPC History Server provides a convenient way to get data out of the DeltaV Continuous Historian and into an OPC Historical Data Access client application.



Benefits

Historical data transfer from the DeltaV


Continuous Historian. The DeltaV OPC History Server provides fast and efficient transfer of historical data from the DeltaV Continuous Historian using the industry standard OPC Historical Data Access specification.

Browsable interface. The DeltaV OPC History Server provides a browsable interface to all OPC Historical Data Access client applications.

Raw, interpolated and calculated data. OPC Historical Data Access client applications may read raw, interpolated and calculated data from the DeltaV Continuous Historian. Interpolated and calculated data may be requested by time or number of intervals. Calculated data includes minimum, maximum, average, standard deviation and many others as noted below. Raw data is read directly from the historian; interpolated and calculated data is computed in the historian interface.

Remote viewing of historical data. OPC Historical Data Access client applications may be located outside the DeltaV System, allowing remote viewing capability of any or all historical data contained in the DeltaV Continuous Historian.

Available on the ProfessionalPLUS Station and Application Station. The DeltaV OPC History Server is available on the ProfessionalPLUS and Application Stations. All you need to do is enable, configure, and download the DeltaV Continuous Historian for the DeltaV OPC History Server to be operational. Since the DeltaV Continuous Historian is available on the ProfessionalPLUS and Application Stations, any size DeltaV system has the capability to expose DeltaV Continuous Historian data through the DeltaV OPC History Server.

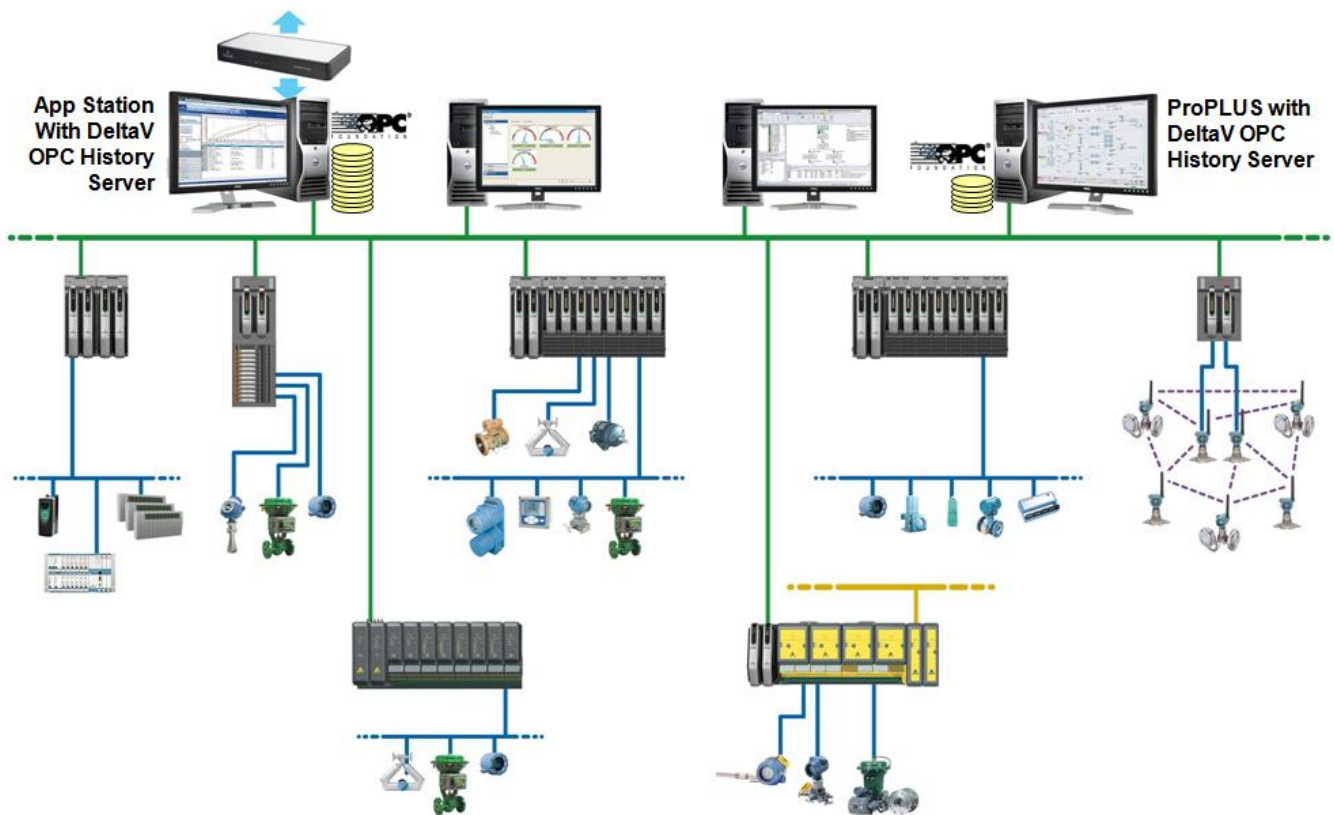

The DeltaV OPC History Server is available on the ProfessionalPLUS Station and the Application Station.

Product Description

The DeltaV OPC History Server provides a read-only interface to the historical data located in the DeltaV Continuous Historian. OPC Historical Data Access clients may use the DeltaV OPC History Server to view all historical data collected in the DeltaV Continuous Historian.

OPC Historical Data Access client applications request historical data for a given period of time. Browsing capability is provided by the DeltaV OPC History Server along with the use of wildcard filtering, making it easy for client applications to view any or all historical data collected in the DeltaV Continuous Historian.

The DeltaV OPC History Server provides OPC Historical Data Access client applications access to raw, interpolated and calculated data from the DeltaV Continuous Historian. Raw data is defined as data that is stored within the historian. The availability of raw data is based on the configuration settings of each parameter configured for history collection. Interpolated data is defined as data that is derived from the raw data in the historian, but for which there is no stored value. Interpolated and calculated data are derived from the raw data values stored in the historian over the given time range.

The DeltaV OPC History Server provides a timestamp and quality value associated with each history data value. For raw data values, the timestamp is the time the value was recorded by the DeltaV Continuous Historian. For interpolated and calculated data values, the timestamp is the start of the requested interval, with two exceptions, minimum and maximum, which can be requested with actual timestamps or interval timestamps.

The DeltaV Continuous Historian captures the quality status of every parameter configured for history collection. The DeltaV parameter quality is available for use by the DeltaV Continuous Historian client applications. The DeltaV parameter quality is also available through the DeltaV OPC History Server. In the DeltaV OPC History Server, the DeltaV parameter status is mapped to the OPC Historical Data Access quality to provide the complete quality status from the DeltaV Continuous Historian.

The DeltaV OPC History Server has access to all of the historical data associated with the plant areas that are assigned to the local DeltaV Continuous Historian. If it is necessary to access all historical data in the DeltaV system, then every plant area must be assigned to the workstation where the DeltaV OPC History Server is in use.

The DeltaV OPC History Server is available on the ProfessionalPLUS Station and the Application Station. The DeltaV OPC History Server is activated when the DeltaV Continuous Historian is enabled, configured, and downloaded. The DeltaV OPC History Server will accept one concurrent OPC Historical Data Access client connection without the need for a license. Additional concurrent OPC Historical Data Access client connections require the purchase of the DeltaV OPC History Server license. The DeltaV OPC History Server may be licensed on the ProfessionalPLUS Station or the Application Station.

Interfaces and Methods

The DeltaV OPC History Server incorporates all of the required interfaces and methods of the OPC Historical Data Access specification. The interfaces supported by the DeltaV OPC History Server are as follows.

- IOPCCommon
- IConnectionPointContainer
- IOPCShutdown
- IOPCHDA_Server
- IOPCHDA_Browser
- IOPCHDA_SyncRead

The IOPCHDA_Server and IOPCHDA_SyncRead interfaces provide information via various methods that is meaningful to users of OPC Historical Data Access clients.

The IOPCHDA_Server interface is the primary interface for the DeltaV OPC History Server. The IOPCHDA_Server interface provides methods for requesting what types of data the DeltaV OPC History Server is able to provide and for setting up access to historical data values. The methods included with this interface are as follows:

- IOPCHDA_Server::GetItemAttributes
- IOPCHDA_Server::GetAggregates
- IOPCHDA_Server::GetHistorianStatus
- IOPCHDA_Server::GetItemHandles
- IOPCHDA_Server::ReleaseItemHandles
- IOPCHDA_Server::ValidateItemIDs
- IOPCHDA_Server::CreateBrowse

The GetItemAttributes method returns the list of standard and vendor specific attributes supported by the DeltaV OPC History Server. The attributes are as follows:

- Data Type
- Stepped
- ItemID
- Maximum Time Interval
- Minimum Time Interval
- Exception Deviation
- Current Module Description
- Current Engineering Units
- Current 0% Range Value (EU0)
- Current 100% Range Value (EU100)
- Last Download
- Currently On Scan
- DeltaV Named Set

The GetAggregates method returns the list of aggregates supported by the DeltaV OPC History Server. The aggregates are as follows.

- Interpolative
- Time Average
- Count
- Minimum Actual Time
- Minimum
- Maximum Actual Time
- Maximum
- Start

- End
- Total
- Average
- Range
- Standard Deviation

The DeltaV OPC History Server provides data to OPC Historical Data Access clients through the SyncRead interface. This interface provides access to the data held by the DeltaV Continuous Historian. The SyncRead interface provides several methods for obtaining various types of data from the DeltaV OPC History Server. The methods included with this interface are as follows:

- IOPCHDA_SyncRead::ReadRaw
- IOPCHDA_SyncRead::ReadProcessed
- IOPCHDA_SyncRead::ReadAttribute

The ReadRaw method reads the values, qualities, and timestamps from the DeltaV Continuous Historian database for the specified time domain for one or more OPC HDA Items.

The ReadProcessed method requests an aggregate value or values to be computed by the DeltaV Continuous Historian for one or more OPC HDA Items, providing values, qualities, and timestamps. See the GetAggregates method for a list of supported aggregates. The ReadProcessed method is an optional method that is not required by the OPC Historical Data Access specification but is available in the DeltaV OPC History Server.

The ReadAttribute method reads the standard and vendor specific attributes and timestamps for an item. The DeltaV OPC History Server returns the current state of these attributes as only the current state is stored in the DeltaV Continuous Historian, with the exception of the attributes identified as "Current". See the GetItemAttributes method for a list of supported attributes.

The vendor specific attributes Current Module Description, Current Engineering Units, Current 0% Range Value and Current 100% Range Value are unique to the DeltaV OPC History Server and represent the current state of these attributes as read from the DeltaV run-time system.

OPC Historical Data Access

The DeltaV OPC History Server is based on the OPC Historical Data Access specification published and maintained by the OPC Foundation.

The DeltaV OPC History Server is separate and distinct from the other DeltaV OPC servers. The DeltaV OPC History Server is the third OPC Server in the DeltaV system, joining the DeltaV OPC Data Server and the DeltaV OPC Events Server. The DeltaV OPC History Server provides access to the historical data collected by the DeltaV system, where the OPC Data Server and OPC Events Server provide access to real-time process data and alarms and events data, respectively. With the DeltaV OPC History Server, historical data can be queried from any point in the past for which data exists all the way up to near real-time. All three OPC Servers share the same client-server architecture that has been the foundation of the OPC standard.

The DeltaV OPC Data Server provides access to real-time process data in the DeltaV system, such as level, pressure, or flow measurements. The DeltaV OPC Data Server implements the OPC Data Access specification. The DeltaV OPC Events Server provides access to real-time alarm and event data in the DeltaV system, such as high level alarms, system events, or operator change actions. The DeltaV Events Server implements the OPC Alarms and Events specification.

As with the other DeltaV OPC Servers, the DeltaV OPC History Server provides fast and powerful information-sharing capabilities with its client applications. Any 3rd party OPC Historical Data Access client application can connect to the DeltaV OPC History Server and retrieve any and all historical data contained in the DeltaV Continuous Historian.

Ordering Information

Description	Model Number
DeltaV OPC History Server*	VE2227*

*The DeltaV OPC History Server license provides up to 25 concurrent OPC Historical Data Access client connections. The first OPC Historical Data Access client connection is provided free of charge. The DeltaV OPC History Server license is required if more than one OPC Historical Data Access client is connected to the server at the same time.

Related Products

- **DeltaV Continuous Historian.** Captures up to 250 analog, discrete and text parameters along with their status and stores them for future analysis. Optionally scalable up to 30,250 parameters on the Application Station.

Related 3rd Party Products

- **OSIsoft PI Protocol Converter.** Provides OSIsoft PI client application connectivity with the DeltaV Continuous Historian.
- **OSIsoft PI OPC Historical Data Access Interface.** Transfer historical data from the DeltaV OPC History Server to an Enterprise PI Server quickly and easily.

Prerequisites

- DeltaV version 7.4 or later
- DeltaV Continuous Historian
- DeltaV ProfessionalPLUS Station or Application Station
- If using a 3rd party OPC Historical Data Access client application on a non-DeltaV workstation, the OPC Remote utility must be installed on the non-DeltaV workstation. The OPC Remote utility is located on the DeltaV software media in the DV_Extras folder.

To locate a sales office near you, visit our website at:

www.EmersonProcess.com/DeltaV

Or call us at:

Asia Pacific: 65.777.8211

Europe, Middle East: 41.41.768.6111

North America, Latin America: +1 800.833.8314 or
+1 512.832.3774

For large power, water, and wastewater applications

contact Power and Water Solutions at:

www.EmersonProcess-powerwater.com

Or call us at:

Asia Pacific: 65.777.8211

Europe, Middle East, Africa: 48.22.630.2443

North America, Latin America: +1 412.963.4000

© Emerson Process Management 2009. All rights reserved. For Emerson Process Management trademarks and service marks, go to: <http://www.emersonprocess.com/home/news/resources/marks.pdf>.

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available on request. We reserve the right to modify or improve the design or specification of such products at any time without notice.



DELTAV

www.EmersonProcess.com/DeltaV



EMERSON
Process Management