


DEPENDING ON TURBULENCE
IN TANK AND MOUNTING ANGLE
THE PROBE MAY NEED TO BE
ANCHORED OR SUPPORTED.

1/2-14 NPT CONDUIT/CABLE
THREAD (BOTH SIDES),
M20x1.5, PG13.5
ADAPTERS (OPTIONAL)

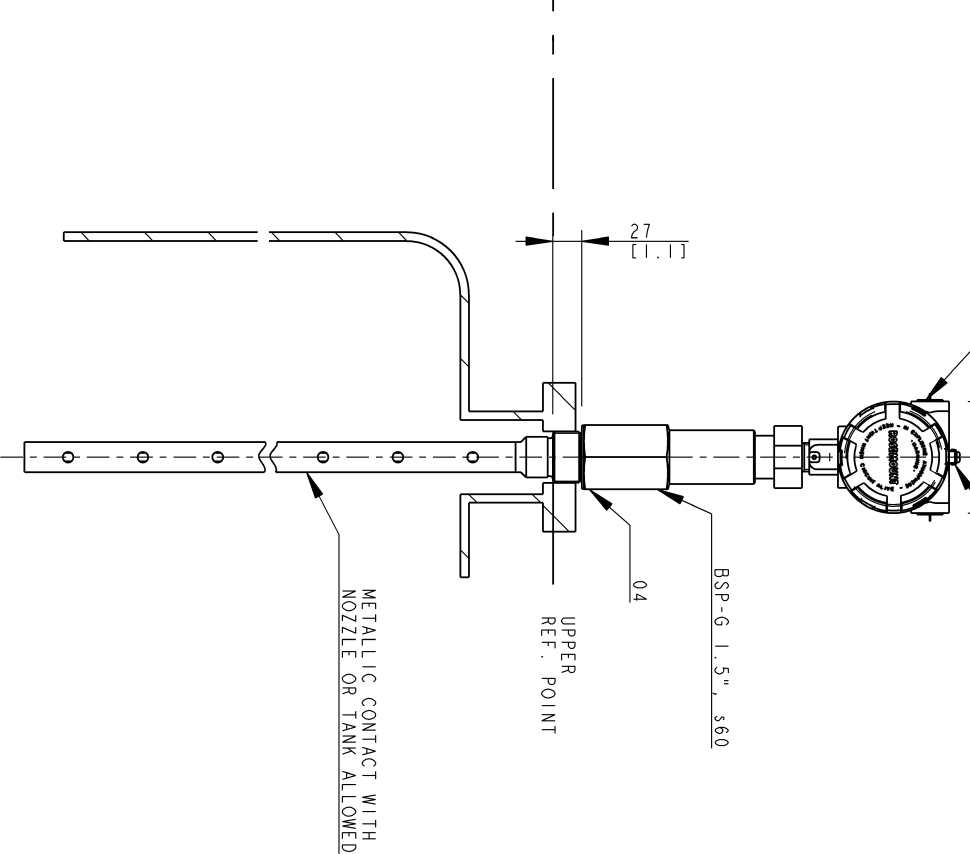

METALLIC CONTACT WITH
NOZZLE OR TANK ALLOWED

1 P/T-RATING FOR FLANGE; SEE REF. MANUAL.

POS	ITEM	DESCRIPTION	QTY	REMARK	SUPPLIER
04	GASKET	ACC. TO BSP-G THREAD STD.	1		CUSTOMER
03	GASKET	SOFT GASKET T-MIN 1.6 (ANSI B16.5/1a, EN1514-1/1BC), SPIRAL WOUND GASKET WITH NON-METALLIC FILLER (ANSI B16.5/1b, EN1514-2), SEE NOTE 1.	1		CUSTOMER
02	SCREW/NUT/WASHER	ACC. TO FLANGE STD. SEE NOTE 1.	-		CUSTOMER
01	FLANGE	DIM. ACC. TO ANSI B 16.5/EN 1092-1, OTHER ON REQUEST. P/T RATING, SEE NOTE 1.	1		RMT

ISSUED BY	WEK	PRODUCT CODE	TITLE	INSTALLATION DRAWING TITLE
GU-TK-T010536	3300		PROBE	MECHANICAL INSTALLATION DWG
GU-HF	0603	9240017-999	1:5	COAXIAL LEAD

FOR MORE INFO, SEE
REFERENCE MANUAL.

ROSEMOUNT

THE COPYRIGHT OWNERSHIP OF THIS DOCUMENT IS AND WILL REMAIN OURS. THE DOCUMENT MUST NOT BE USED WITHOUT OUR AUTHORIZATION OR BROUGHT TO THE KNOWLEDGE OF A THIRD PARTY. CONTRAVENTION WILL BE PROSECUTED. ROSEMOUNT TANK RADAR AB, SWEDEN.